


REVISED 3/11/94

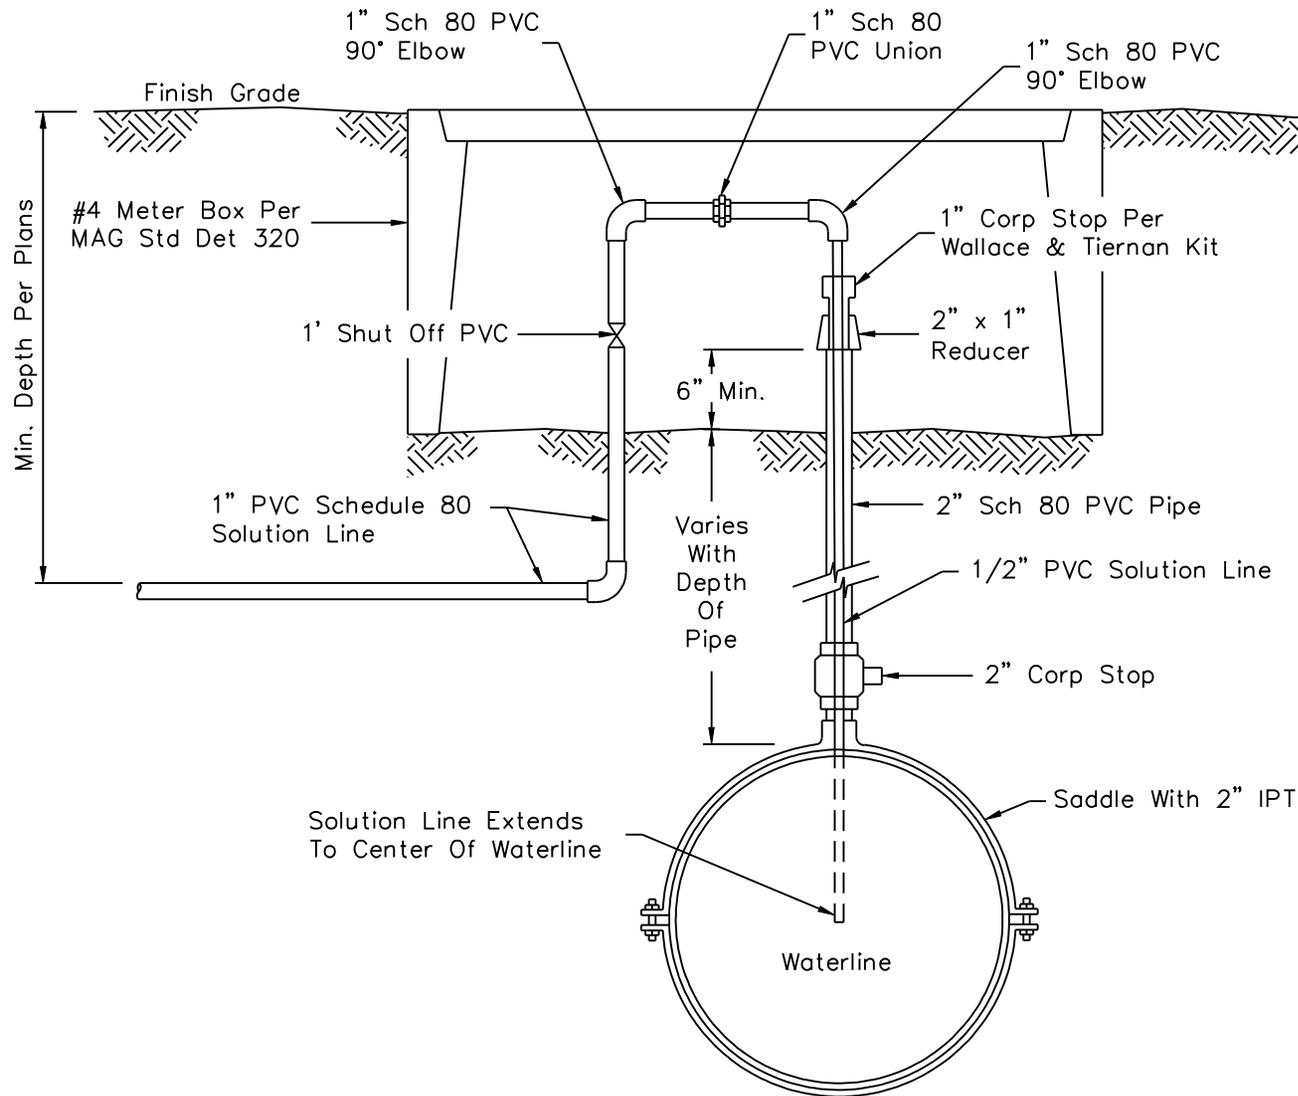

**NOTE:**

Specifications on all fittings shall exceed the maximum pressures of the system.

DETAIL NO.  
**2332**

**City of Scottsdale  
Standard Details**

APPROVED BY:  
**Scottsdale Standards &  
Specifications Committee**

**CHLORINE INJECTION TAP  
FOR UNDERGROUND WATERLINES**

DETAIL NO.  
**2332**