


SECTION A-A

Insulate Water Main From Concrete Box With 1" Ramneck Or Other Expansion Material Approved By The Engineer. Grout Balance Of Opening Per MAG Specifications.

Finish Grade

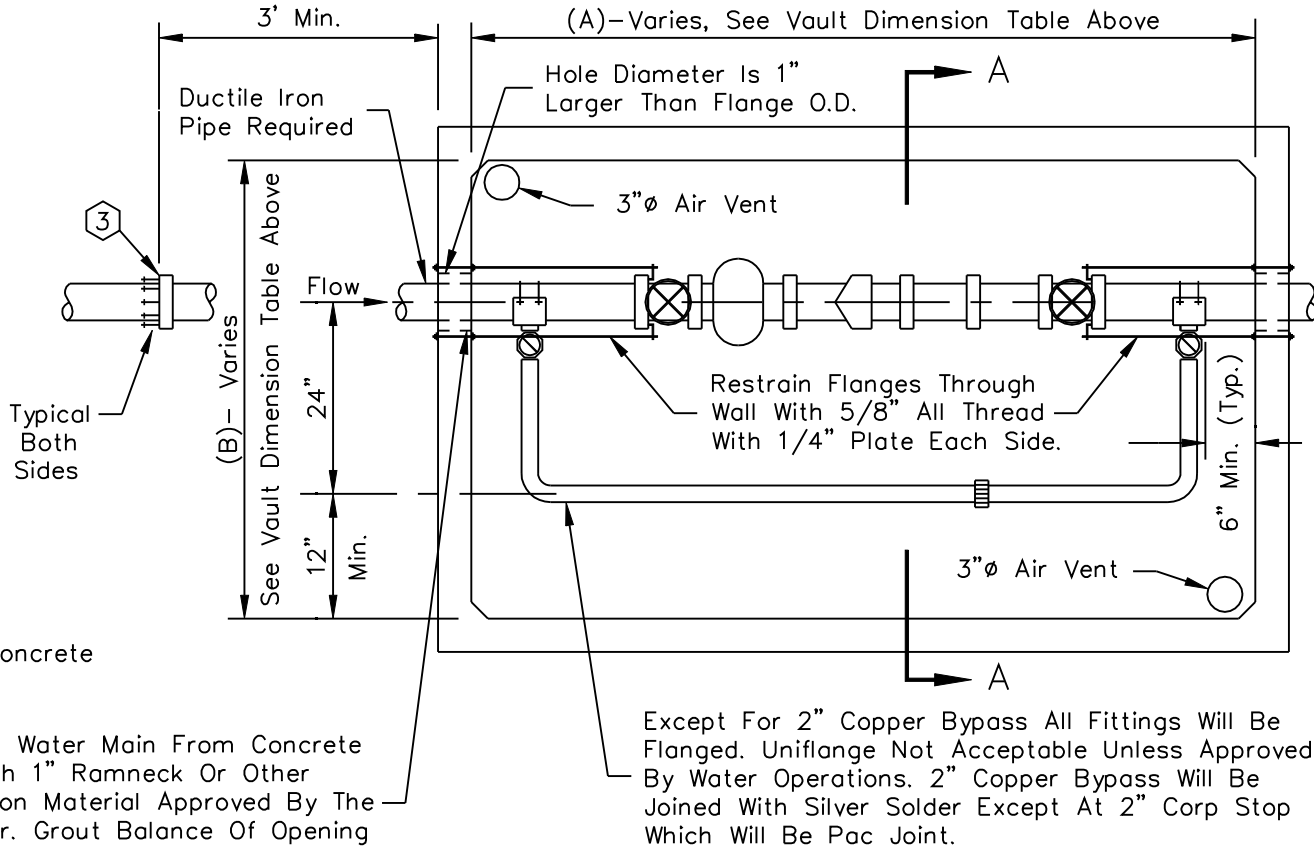

PLAN

VAULT DIMENSION TABLE			
MAIN SIZE	3"	4"	6"
(A)	8'-4"	10'-6"	12'-0"
(B)	4'-6"	5'-0"	5'-0"

## VAULT INSTALLATION

DETAIL NO.  
**2345-1**

**City of Scottsdale  
Standard Details**

APPROVED BY:  
**Scottsdale Standards &  
Specifications Committee**

**3", 4", 6" WATER METER**

DETAIL NO.  
**2345-1**

SHEET 1 OF 2