


REVISED 4/25/07

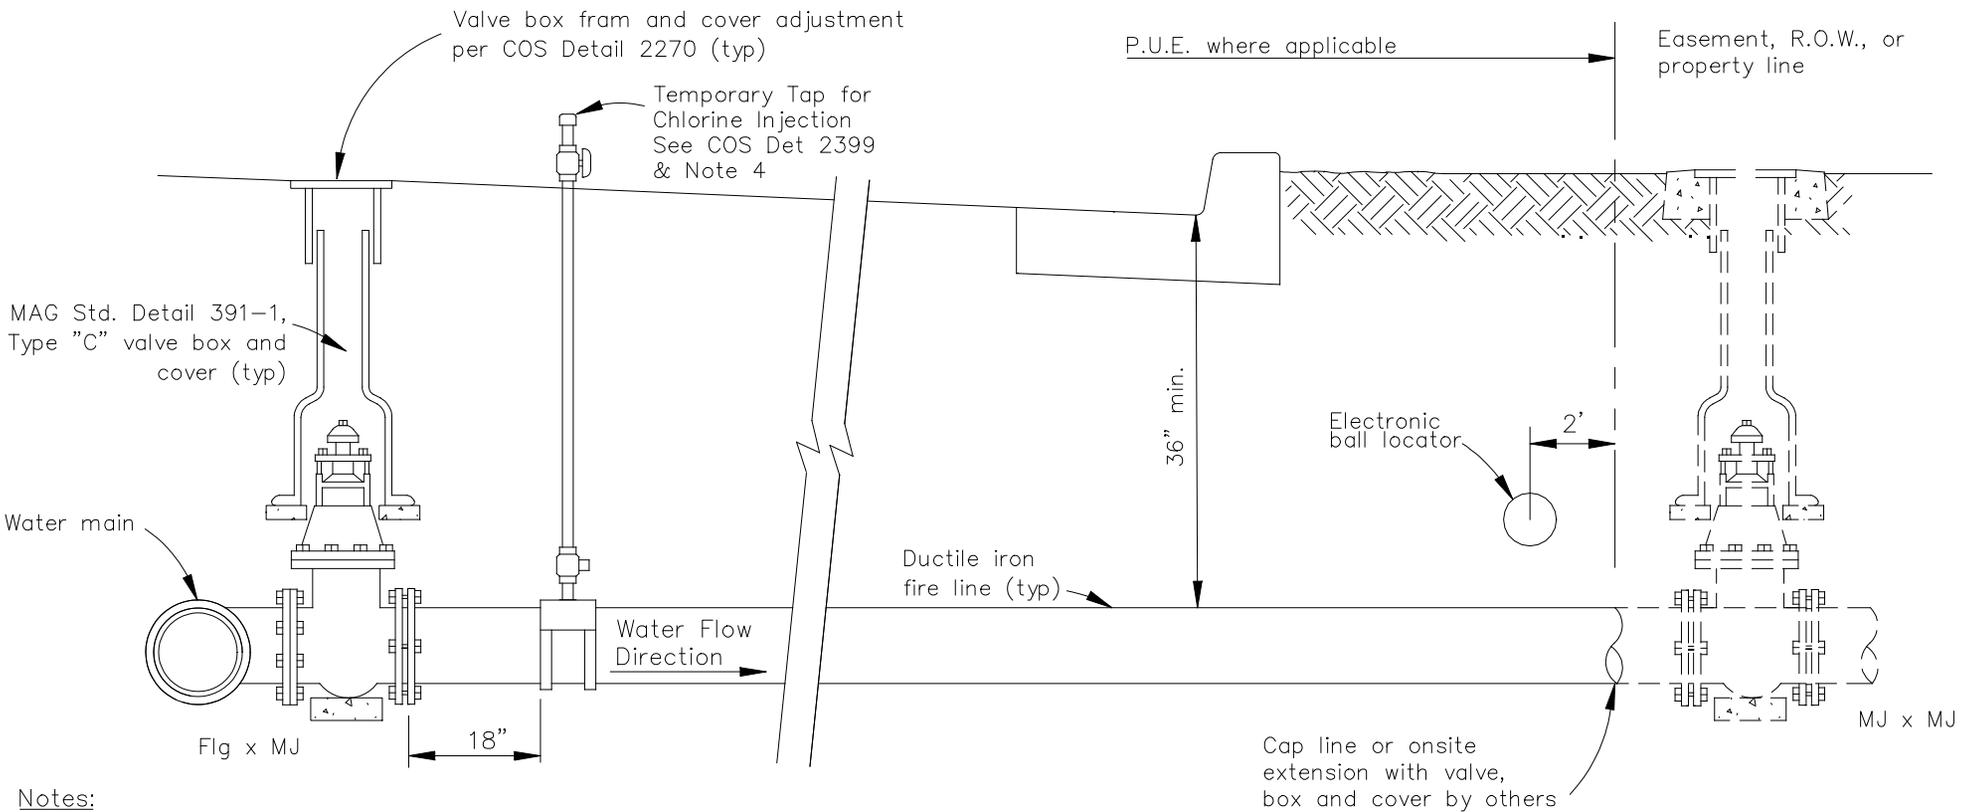

Notes:

1. All water lines within the right-of-way or public utility easement shall be polywrapped ductile iron pipe.
2. Joint restraint shall conform to the requirements of MAG Std. Detail 303.
3. When a water main is located behind the curb at the near side of the street, the gate valve by others is not required when the fire line is extended onto private property.
4. All 3" and larger fire lines are required to be disinfected and tested in accordance with MAG Section 611. A corporation stop shall be inserted in the top of the pipe 18" downstream from the tapping valve and will be used as the chlorine injection point.

DETAIL NO. 2362-2	City of Scottsdale Standard Details	APPROVED BY: Scottsdale Standards & Specifications Committee	3" AND LARGER FIRE LINE CONNECTION	DETAIL NO. 2362-2
-----------------------------	--	--	---	-----------------------------