


CROSSING

LEGEND:

- D1 = $\begin{cases} 3' \text{ Min. for pipe } < 12'' \text{ dia.} \\ 4' \text{ Min. for pipe } = 12'' \text{ dia.} \\ 5' \text{ Min. for pipe } > 12'' \text{ dia.} \end{cases}$
- D2 = Minimum Cover
- W = Horizontal Separation

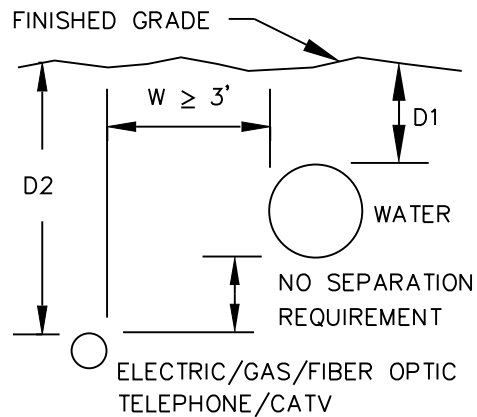

NOTES:

1. Electric separation requirements are for primary electric conductors only. For service conductors see plans.
2. Primary electric, gas, telephone, cable TV or fiber optic lines shall not cross above a water line without written approval from the City's Water Resources Department. If this approval is obtained, a utility locator strip and ABC slurry conforming to COS Specifications Sec. 601.3.6 are required.

DETAIL NO.
2372

City of Scottsdale
Standard Details

APPROVED BY:
Scottsdale Standards & Specifications Committee

MINIMUM UTILITY
SEPARATION REQUIREMENTS

DETAIL NO.
2372