



GENERAL NOTES

1. Provide Building I.D. On Remote Fire Dept. Connection.
2. No Trees, Bushes Or Walls Within 5' Radius Of Fire Dept. Connection
3. If Fire Sprinkler Design Indicates Demand Of 1000 GPM Or Greater, The Underground Fire Dept. Connection Line Shall Be Increased To 6" Diameter With A Three Way 2 1/2" Fire Dept. Hose Connection
4. 4' Min. To Back Of Curb, or 2' Min To Back Of Sidewalk, or When No Curb, 4' Max. Outside The Clear Zone.

2 1/2" X 2 1/2" X 4"
FIRE DEPARTMENT
CONNECTION NST



TOP VIEW

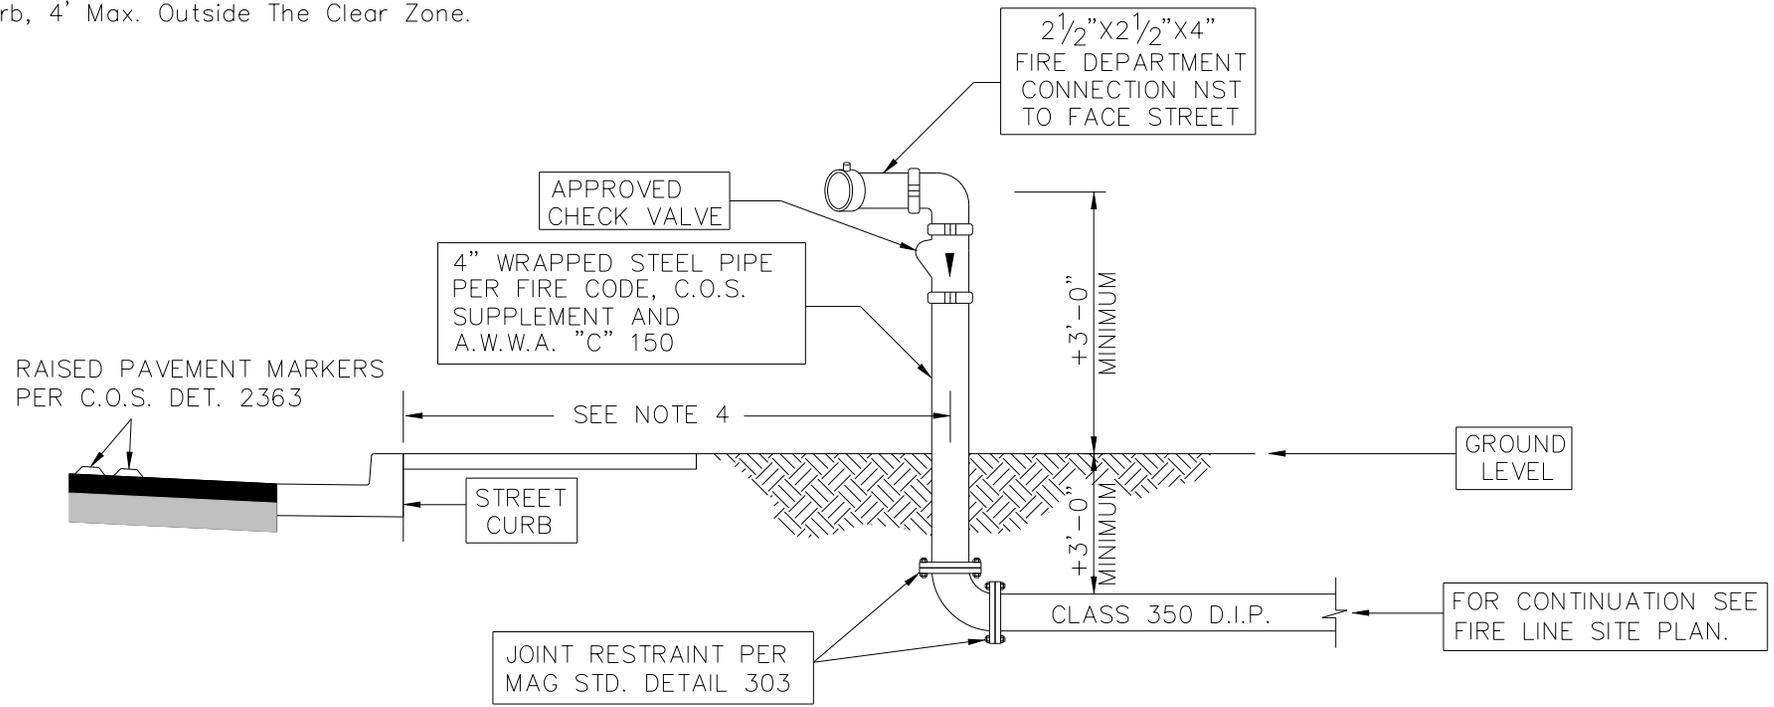

SIDE VIEW

REVISED 12/21/11

DETAIL NO. 2367	City of Scottsdale Standard Details	APPROVED BY: Scottsdale Standards & Specifications Committee	FIRE DEPARTMENT REMOTE SIAMESE CONNECTION	DETAIL NO. 2367
---------------------------	---	--	--	---------------------------