


REVISED 1/18/12

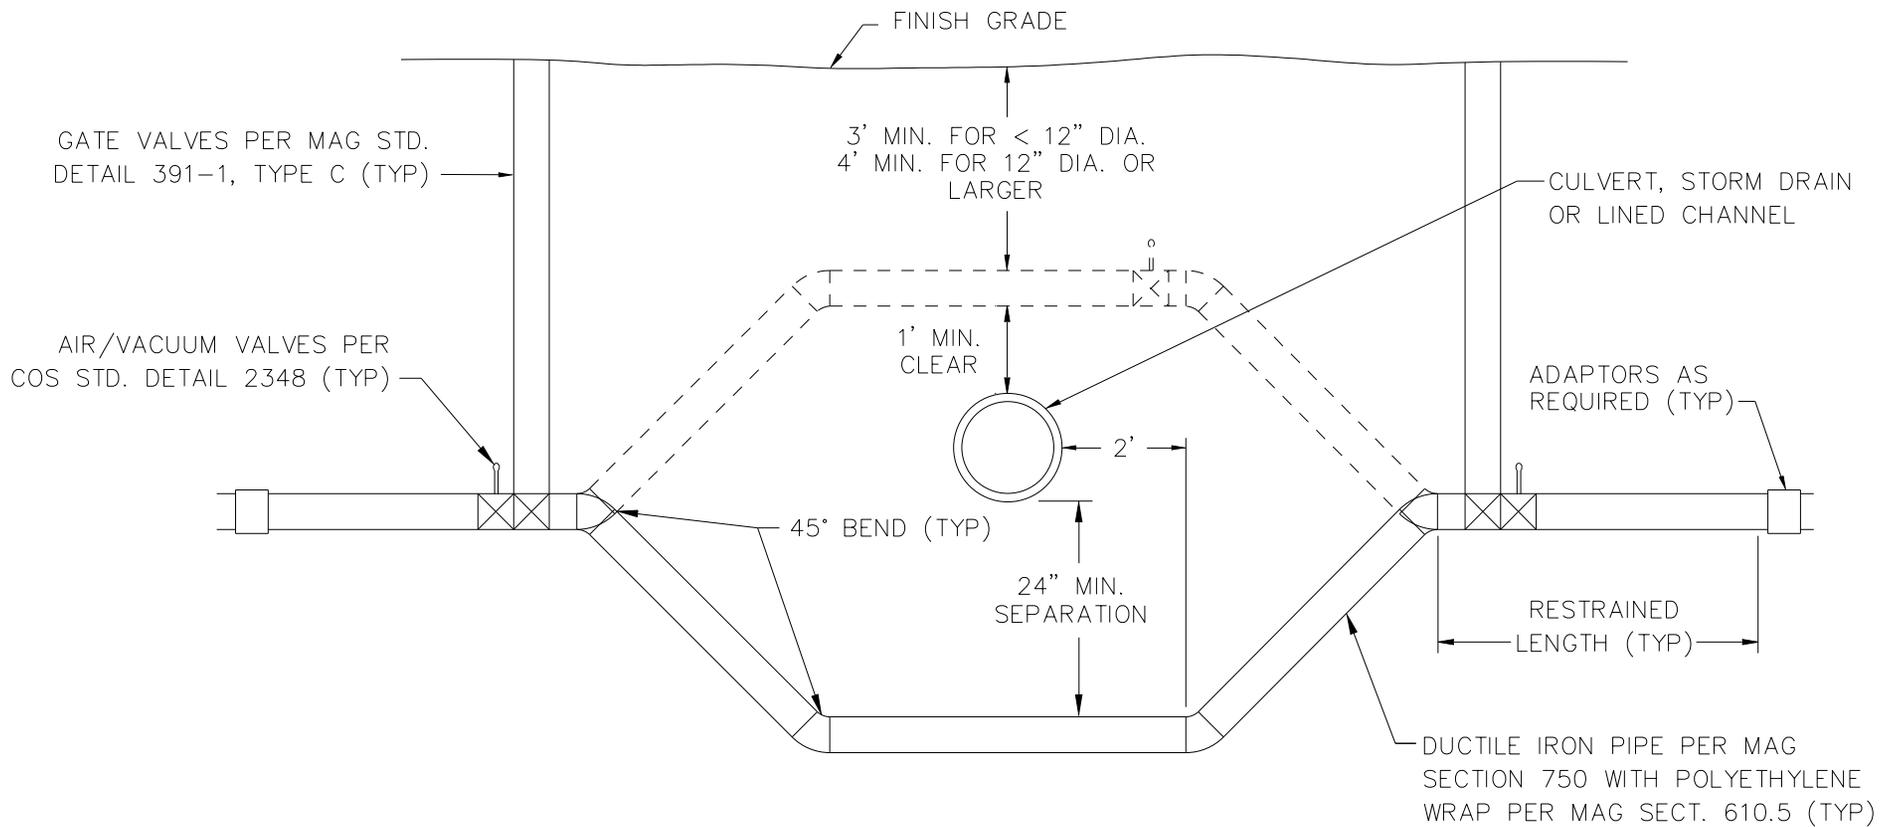

NOTES:

1. DETAIL ONLY ILLUSTRATES MINIMUM SEPARATION AND COVER REQUIREMENTS.
2. QUANTITIES FOR PIPE, FITTINGS, VALVES AND RESTRAINT PER PLANS, INCLUDING ANY REMOVALS, TEMPORARY SUPPORT, SURFACE RESTORATION, ETC.
3. ALL JOINTS TO BE RESTRAINED PER MAG STD. DETAIL 303-1 AND 303-2 UNLESS OTHERWISE NOTED ON THE PLANS.
4. GATE VALVES AND AIR/VACUUM VALVES INSTALLED AS SHOWN UNLESS NOTED OTHERWISE ON THE PLANS.
5. BENDS NOT ADJACENT TO A GATE VALVE SHALL BE INSTALLED WITH BALL MARKERS PER COS STD. DETAIL 2397.

DETAIL NO.
2370

**City of Scottsdale
Standard Details**

APPROVED BY:
**Scottsdale Standards &
Specifications Committee**

VERTICAL REALIGNMENT OF WATER MAINS

DETAIL NO.
2370