


NOTES:


1. ALL CONCRETE TO BE CLASS "B", MAG SECTION 725.
2. ALL RAMPS AND DETECTABLE WARNING SHALL BE ALIGNED PERPENDICULAR TO THE CURB. CROSSWALKS SHALL BE ALIGNED PERPENDICULAR TO THE STREET CENTERLINE AS MUCH AS POSSIBLE.
3. SEE PLANS FOR LOCATION OF SIDEWALK RAMP CENTERLINE.
4. WIDTH OF RAMP SHALL MATCH SIDEWALK WIDTH, 5' MINIMUM.

LEGEND

- 12:1 MAXIMUM SLOPE, 15:1 DESIRED SLOPE
- 2% MAXIMUM SLOPE, 1.5% MINIMUM SLOPE
- 8" SIDEWALK RAMP PAYMENT LIMITS AND HEAVY ROUGH BROOM FINISH LIMITS

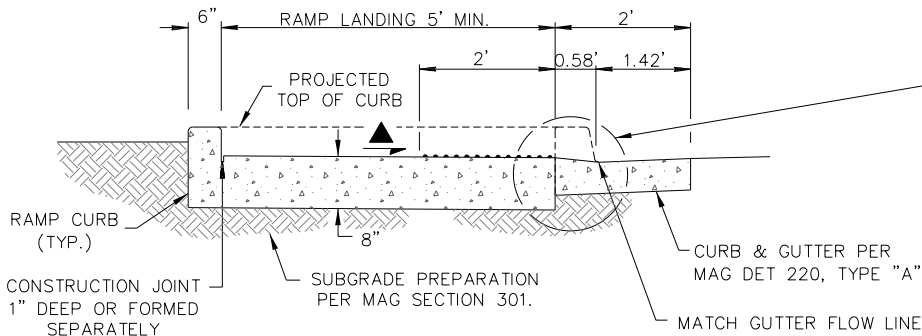

SECTION A-A

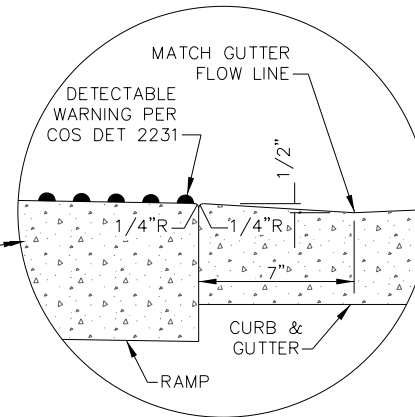

DETAIL 1

DETAIL NO.
2235-2

**City of Scottsdale
Standard Details**

APPROVED BY:
**Scottsdale Standards &
Specifications Committee**

MID-BLOCK SIDEWALK RAMP - TYPE B

DETAIL NO.
2235-2