REVISED 5/19/15

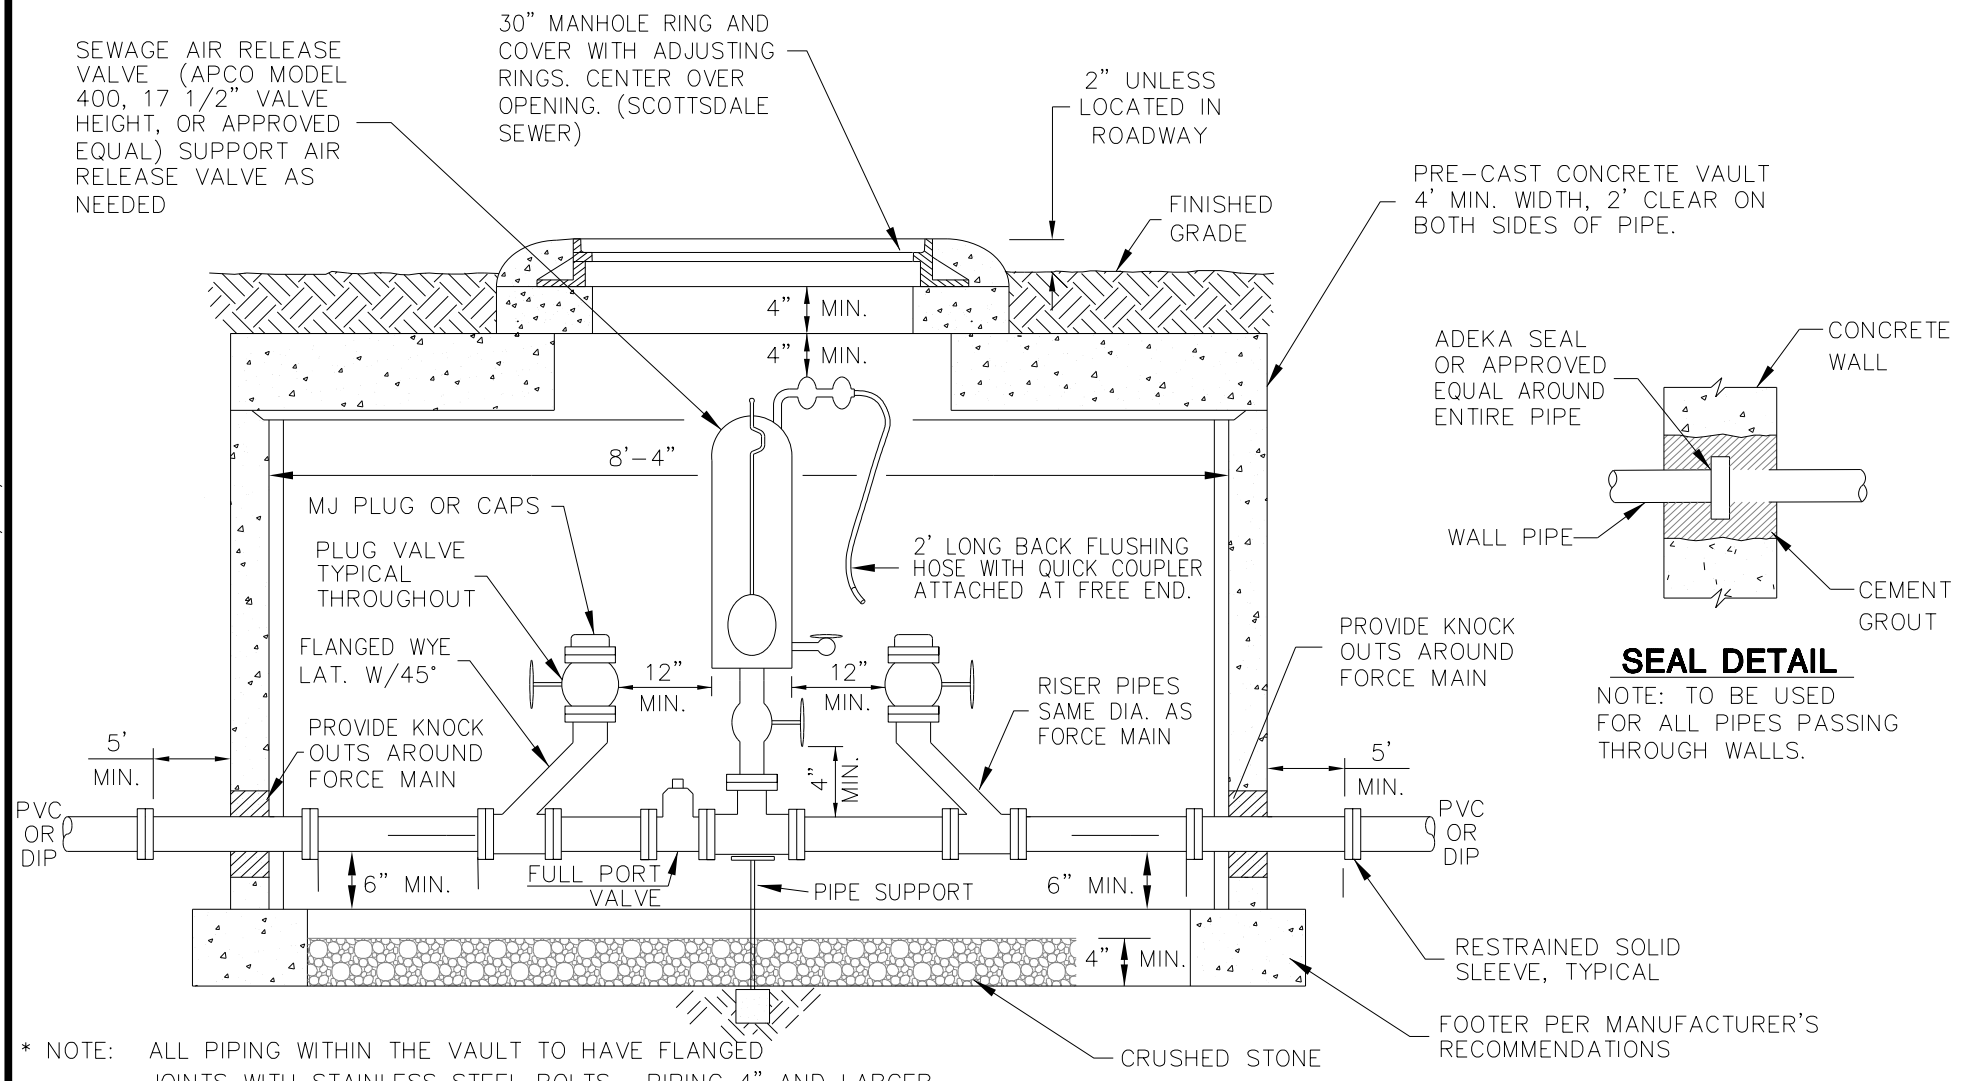

* NOTE: ALL PIPING WITHIN THE VAULT TO HAVE FLANGED JOINTS WITH STAINLESS STEEL BOLTS. PIPING 4" AND LARGER TO BE DUCTILE IRON; ALL OTHER PIPING TO BE PAINTED STEEL.

DETAIL NO. 2404	City of Scottsdale Standard Details	APPROVED BY: Scottsdale Standards & Specifications Committee	FORCE MAIN CLEANOUT WITH SEWAGE AIR RELEASE VALVE	DETAIL NO. 2404