REVISED 2/22/99

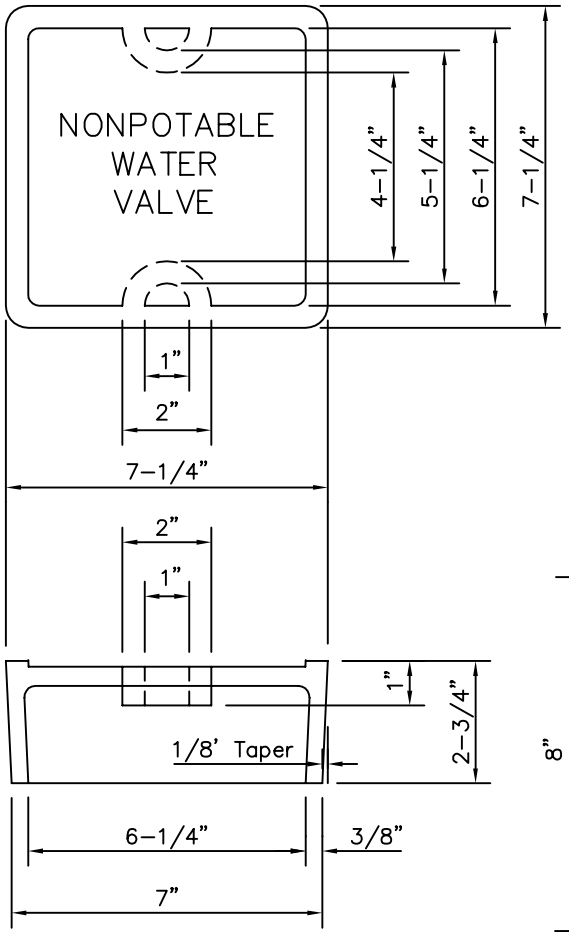

NOTES

1. Round bottom for riser pipe, square top for cover.
2. All materials shall be cast iron per ASTM A48, Class 30B.
3. Nonpotable water valve box to be installed per M.A.G. Std. Detail 391.
4. The cast iron lid shall be marked "Nonpotable Water Valve" on the top side. Letters shall be 1" each and raised 1/8".

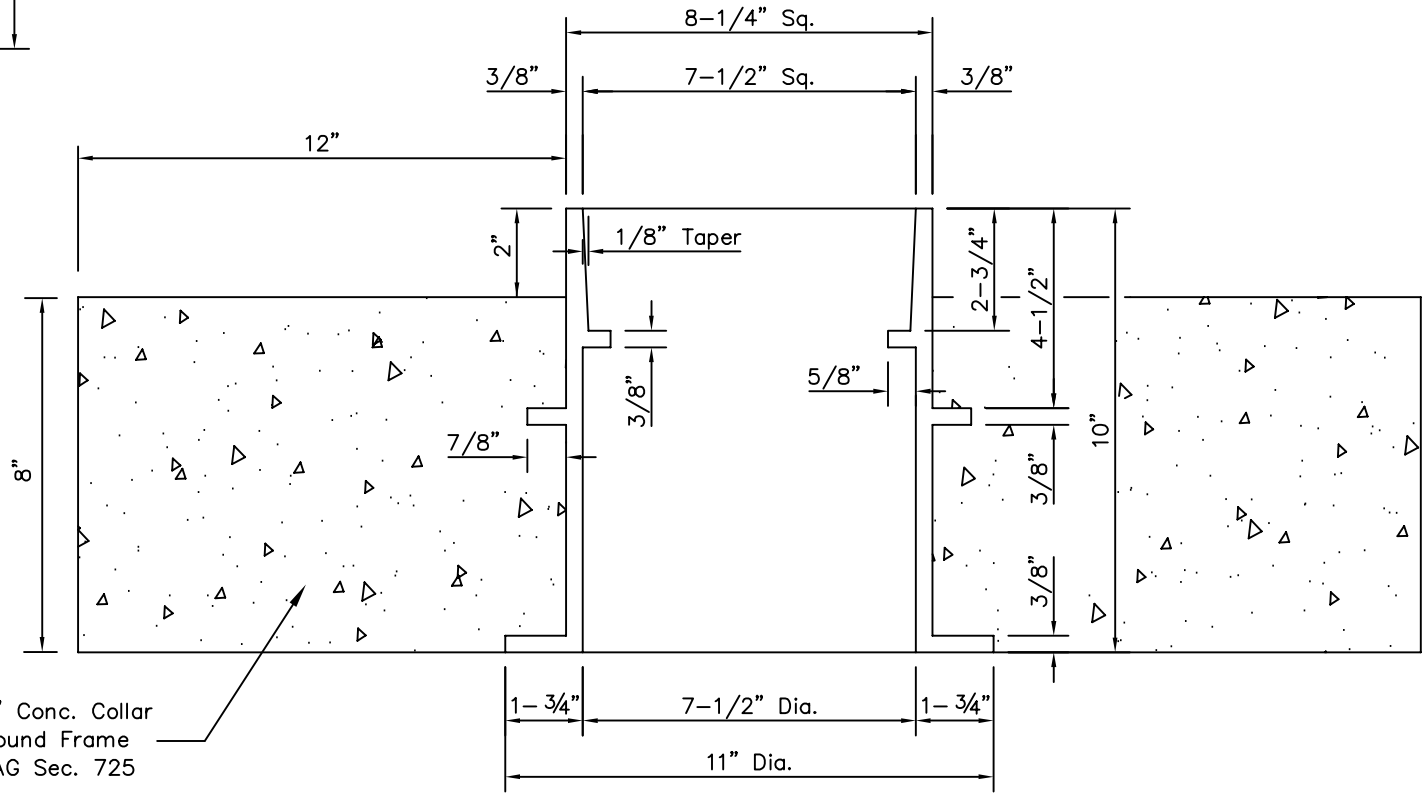

DETAIL NO.		APPROVED BY:		DETAIL NO.
2315	**City of Scottsdale Standard Details**		**NONPOTABLE WATER VALVE BOX & COVER**	2315