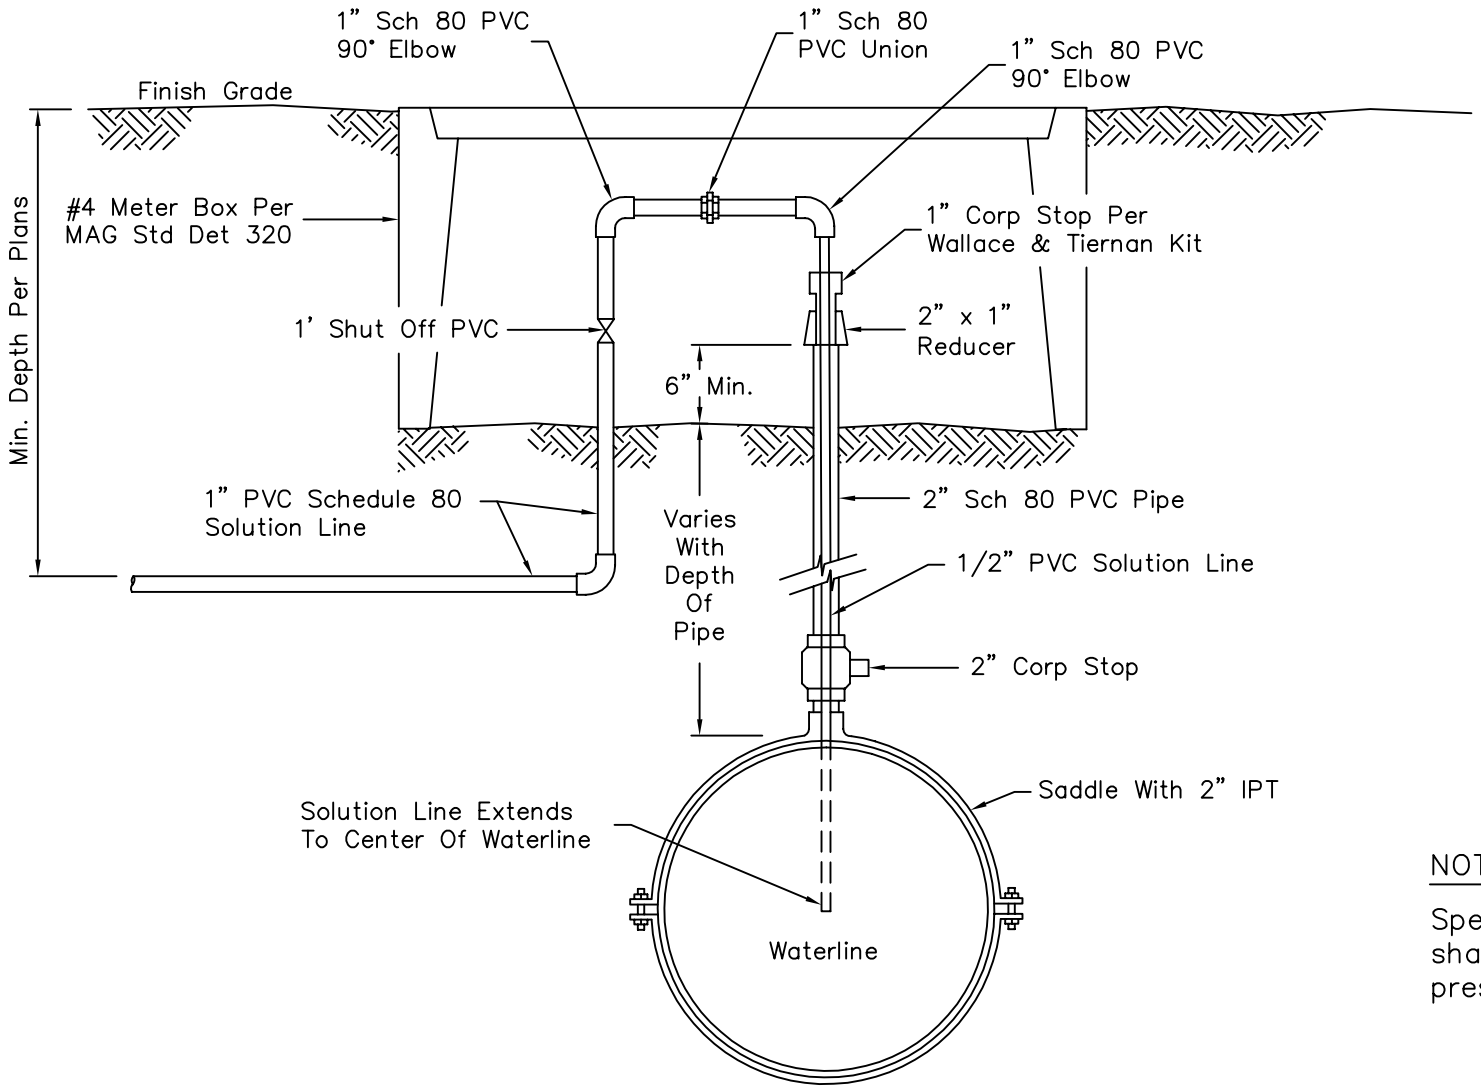

NOTE:

Specifications on all fittings shall exceed the maximum pressures of the system.

REVISED 3/11/94

DETAIL NO.	City of Scottsdale Standard Details	APPROVED BY:	CHLORINE INJECTION TAP FOR UNDERGROUND WATERLINES	DETAIL NO.
2332				2332