NOTE:

1. BALL VALVE SHALL MATCH NOMINAL SIZE OF MAINLINE PIPE.

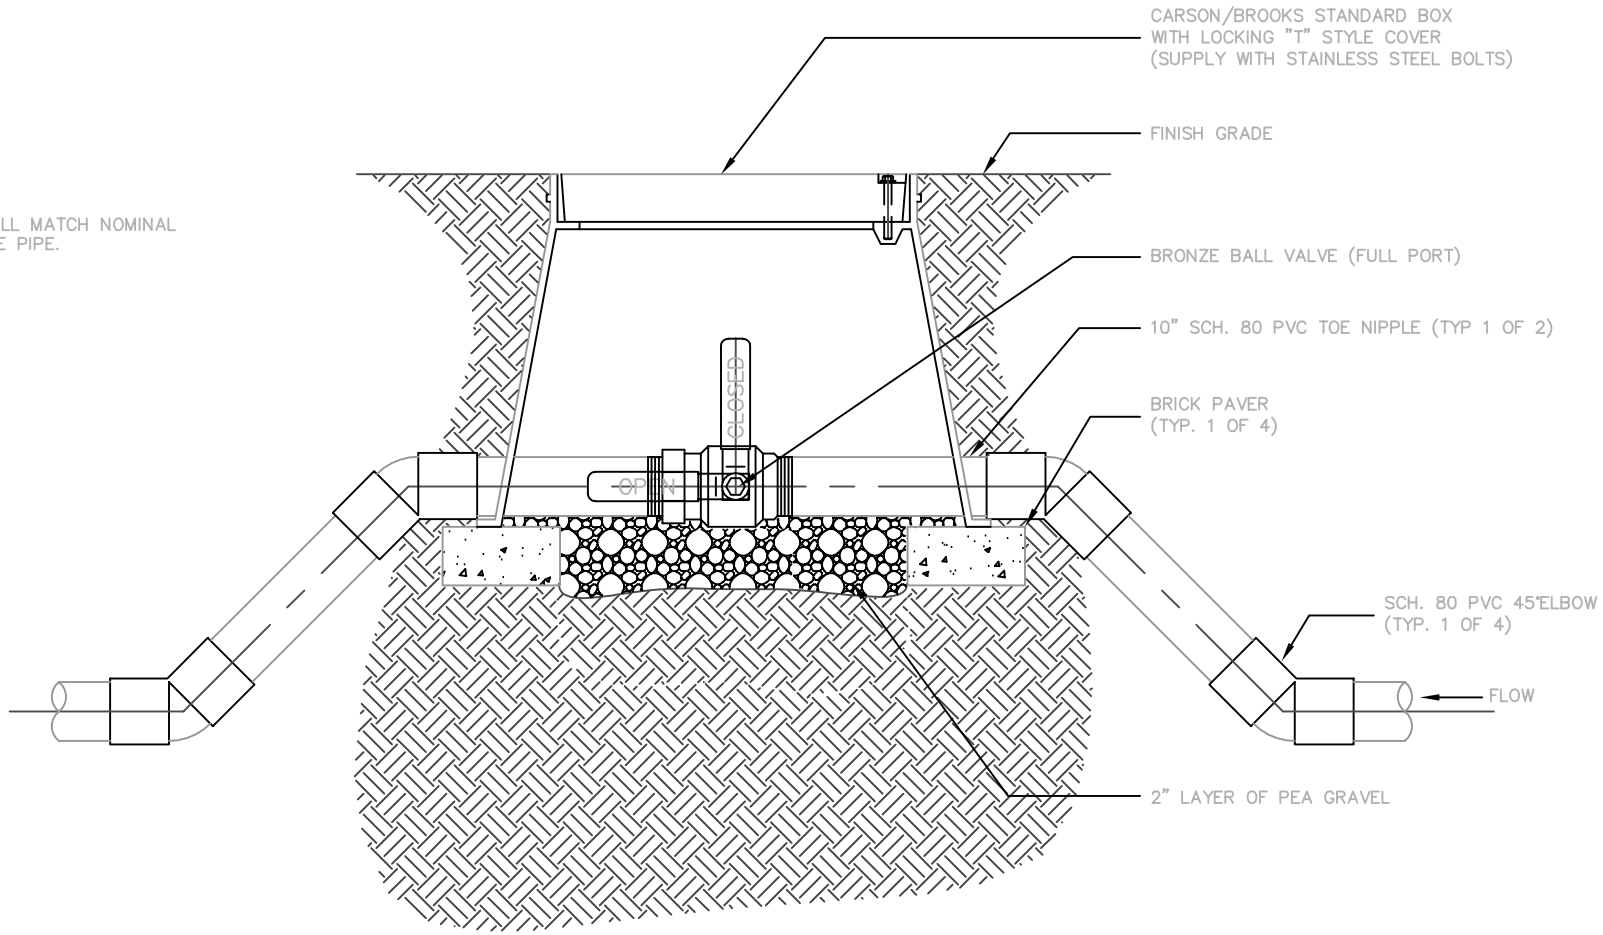

2-1/2" & SMALLER MAINLINE ISOLATION BALL VALVE ASSEMBLY

SCALE: NTS

REVISED: 4/25/02

DETAIL NO. 2650	City of Scottsdale Standard Details	1-1/2" & SMALLER MAINLINE BALL VALVE	DETAIL NO. 2650