NOTE:

1. GATE VALVE SHALL MATCH NOMINAL SIZE OF MAINLINE PIPE.
2. PROTECT VALVE BODY WITH 10MIL PLASTIC PRIOR TO INSTALLATION OF REBAR & SUPPORT BLOCK.

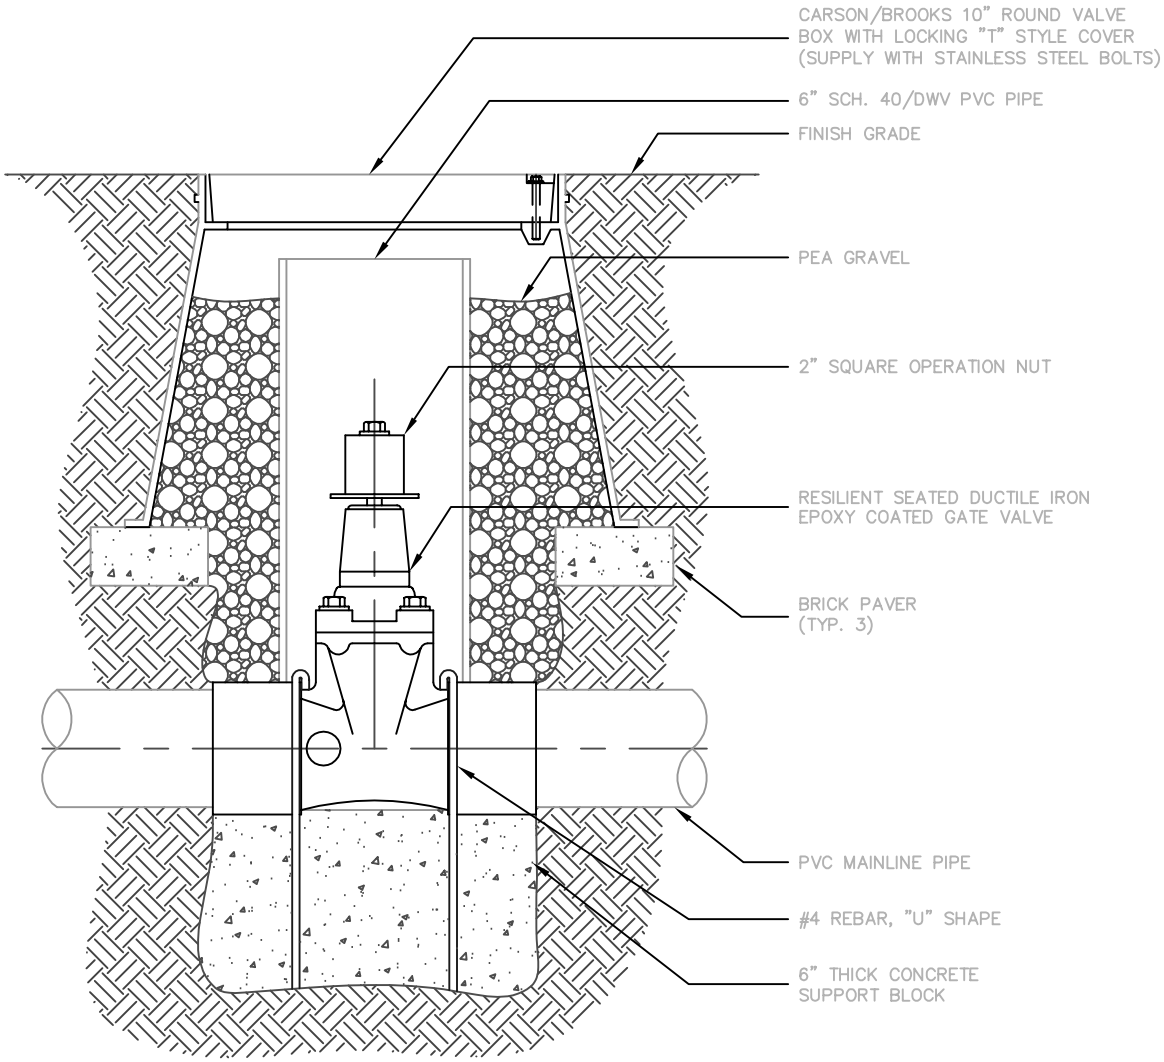

3" & LARGER MAINLINE ISOLATION GATE VALVE ASSEMBLY

SCALE: NTS

REVISED: 4/25/02

DETAIL NO. 2651	City of Scottsdale Standard Details	2" & LARGER MAINLINE ISOLATION GATE VALVE	DETAIL NO. 2651